

CLEARANCES TO COMBUSTIBLES 6041(TP)(HF)

The heater must be installed with the following minimum clearances to side and back wall combustible materials.



NOTE: These are minimum clearances to combustible walls established by the testing lab.

PARALLEL - A - Sidewall to Top Edge of Unit
B - Sidewall to Flue
C - Backwall to Flue
D - Backwall to Unit

8 in./203mm
13 in./330mm
3 in./75mm
9 in./228mm


CORNER - E - Adjacent Wall to Flue
F - Adjacent Wall to Unit

3 in./75mm
4 in./100mm

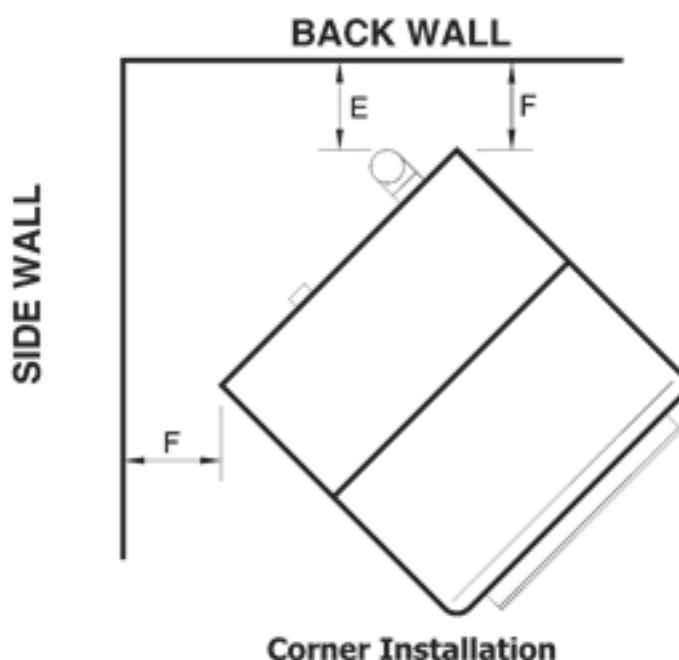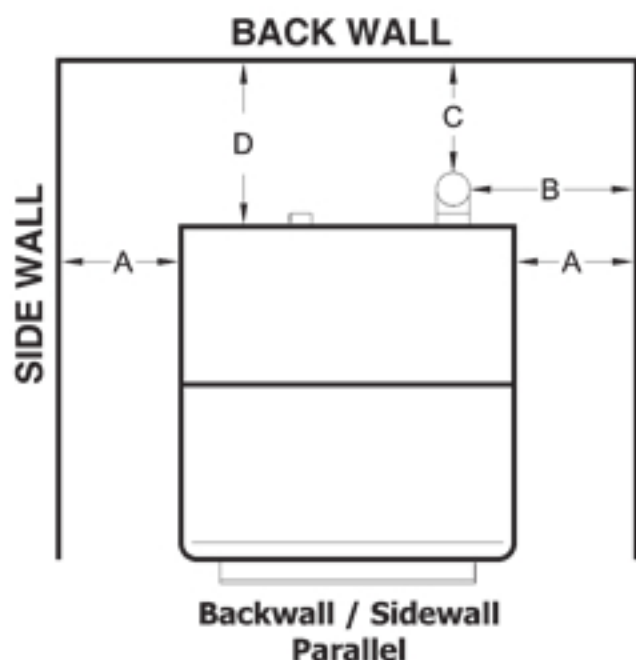

NOTE:

Allow sufficient space to remove the left and right side panels for maintenance purposes.

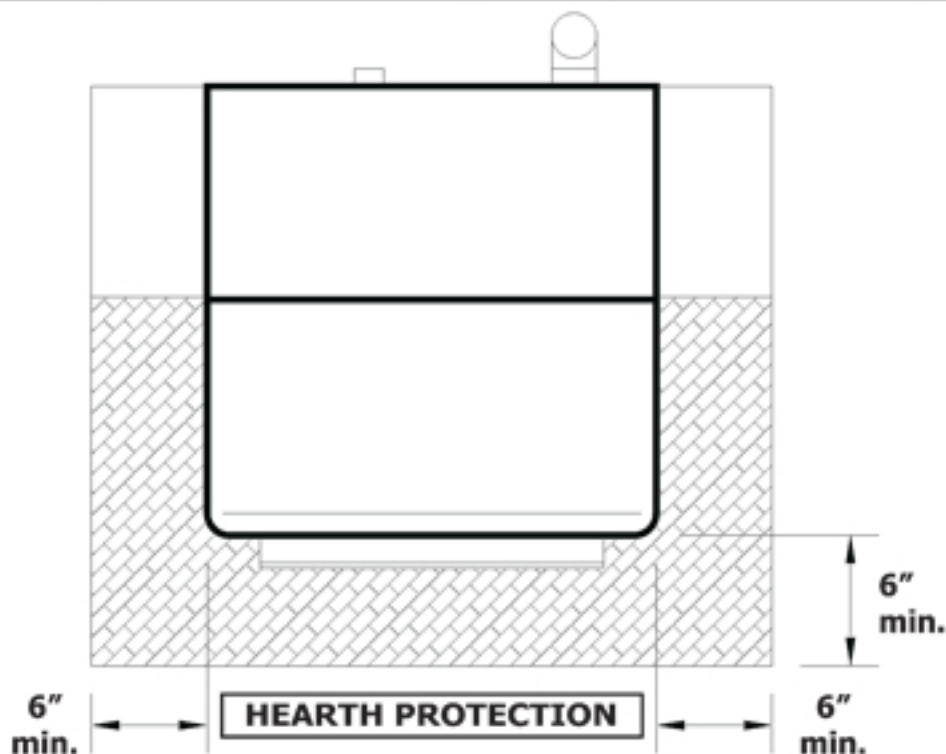

These clearances must be maintained.